
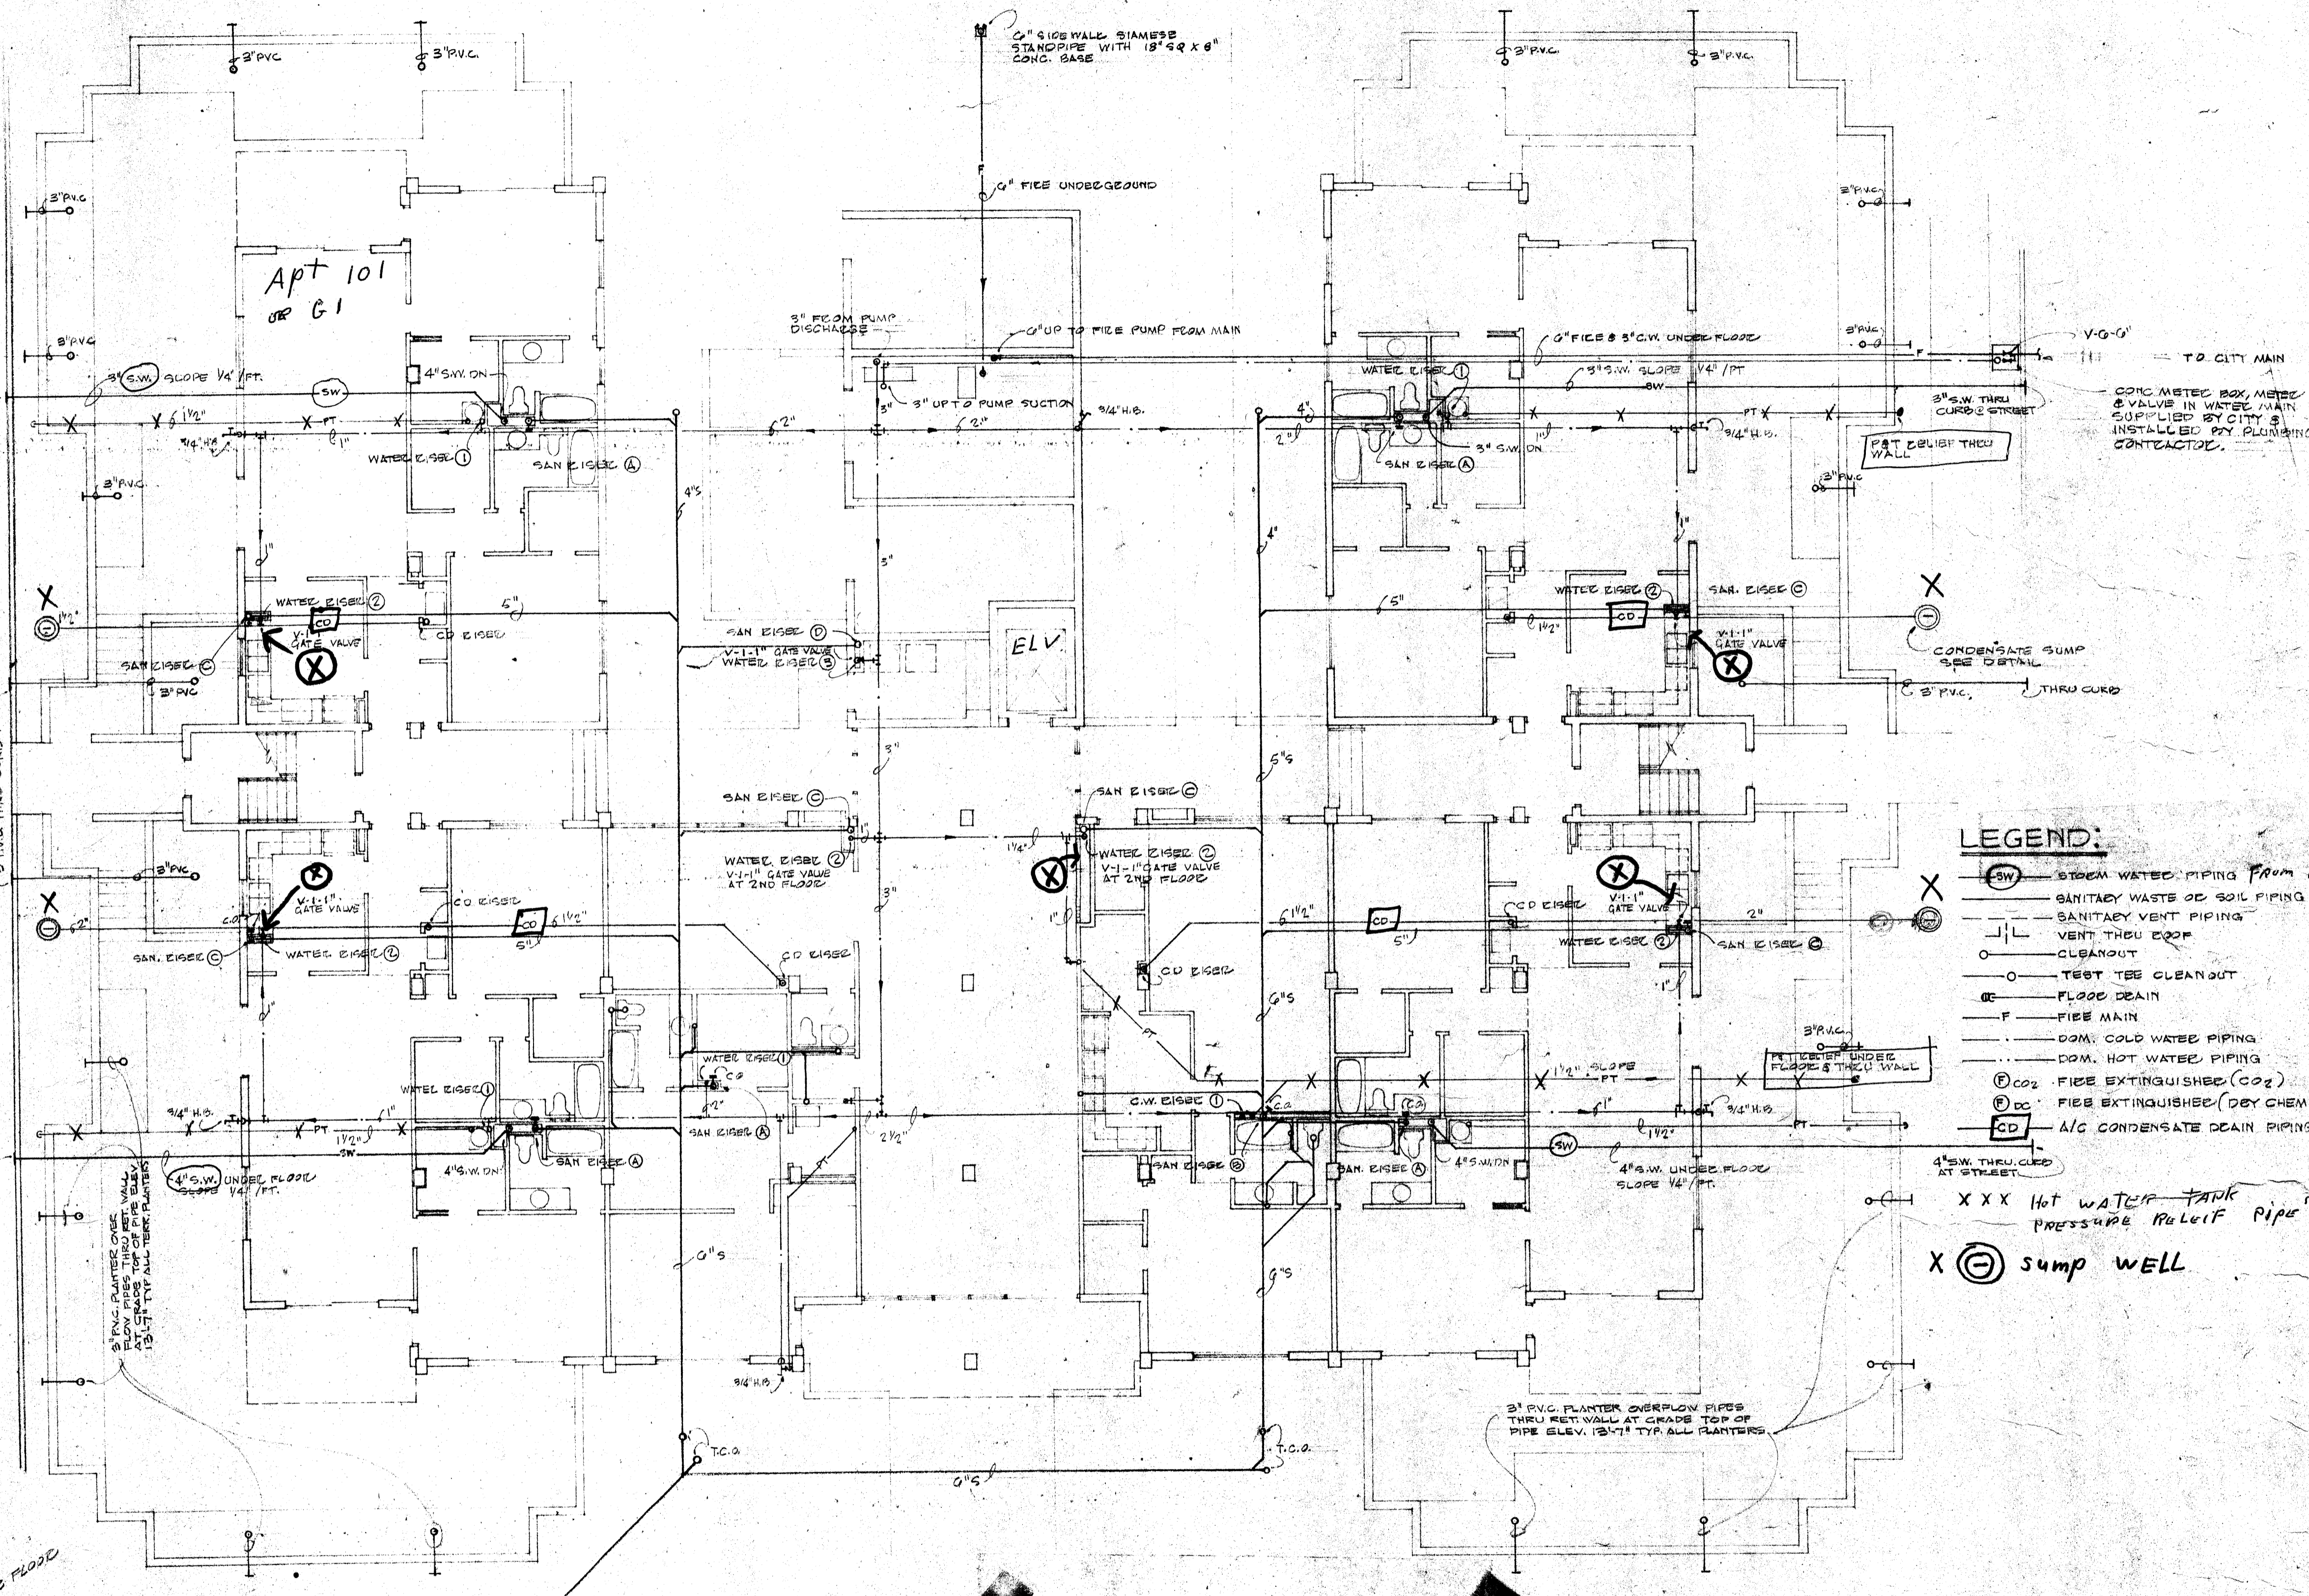
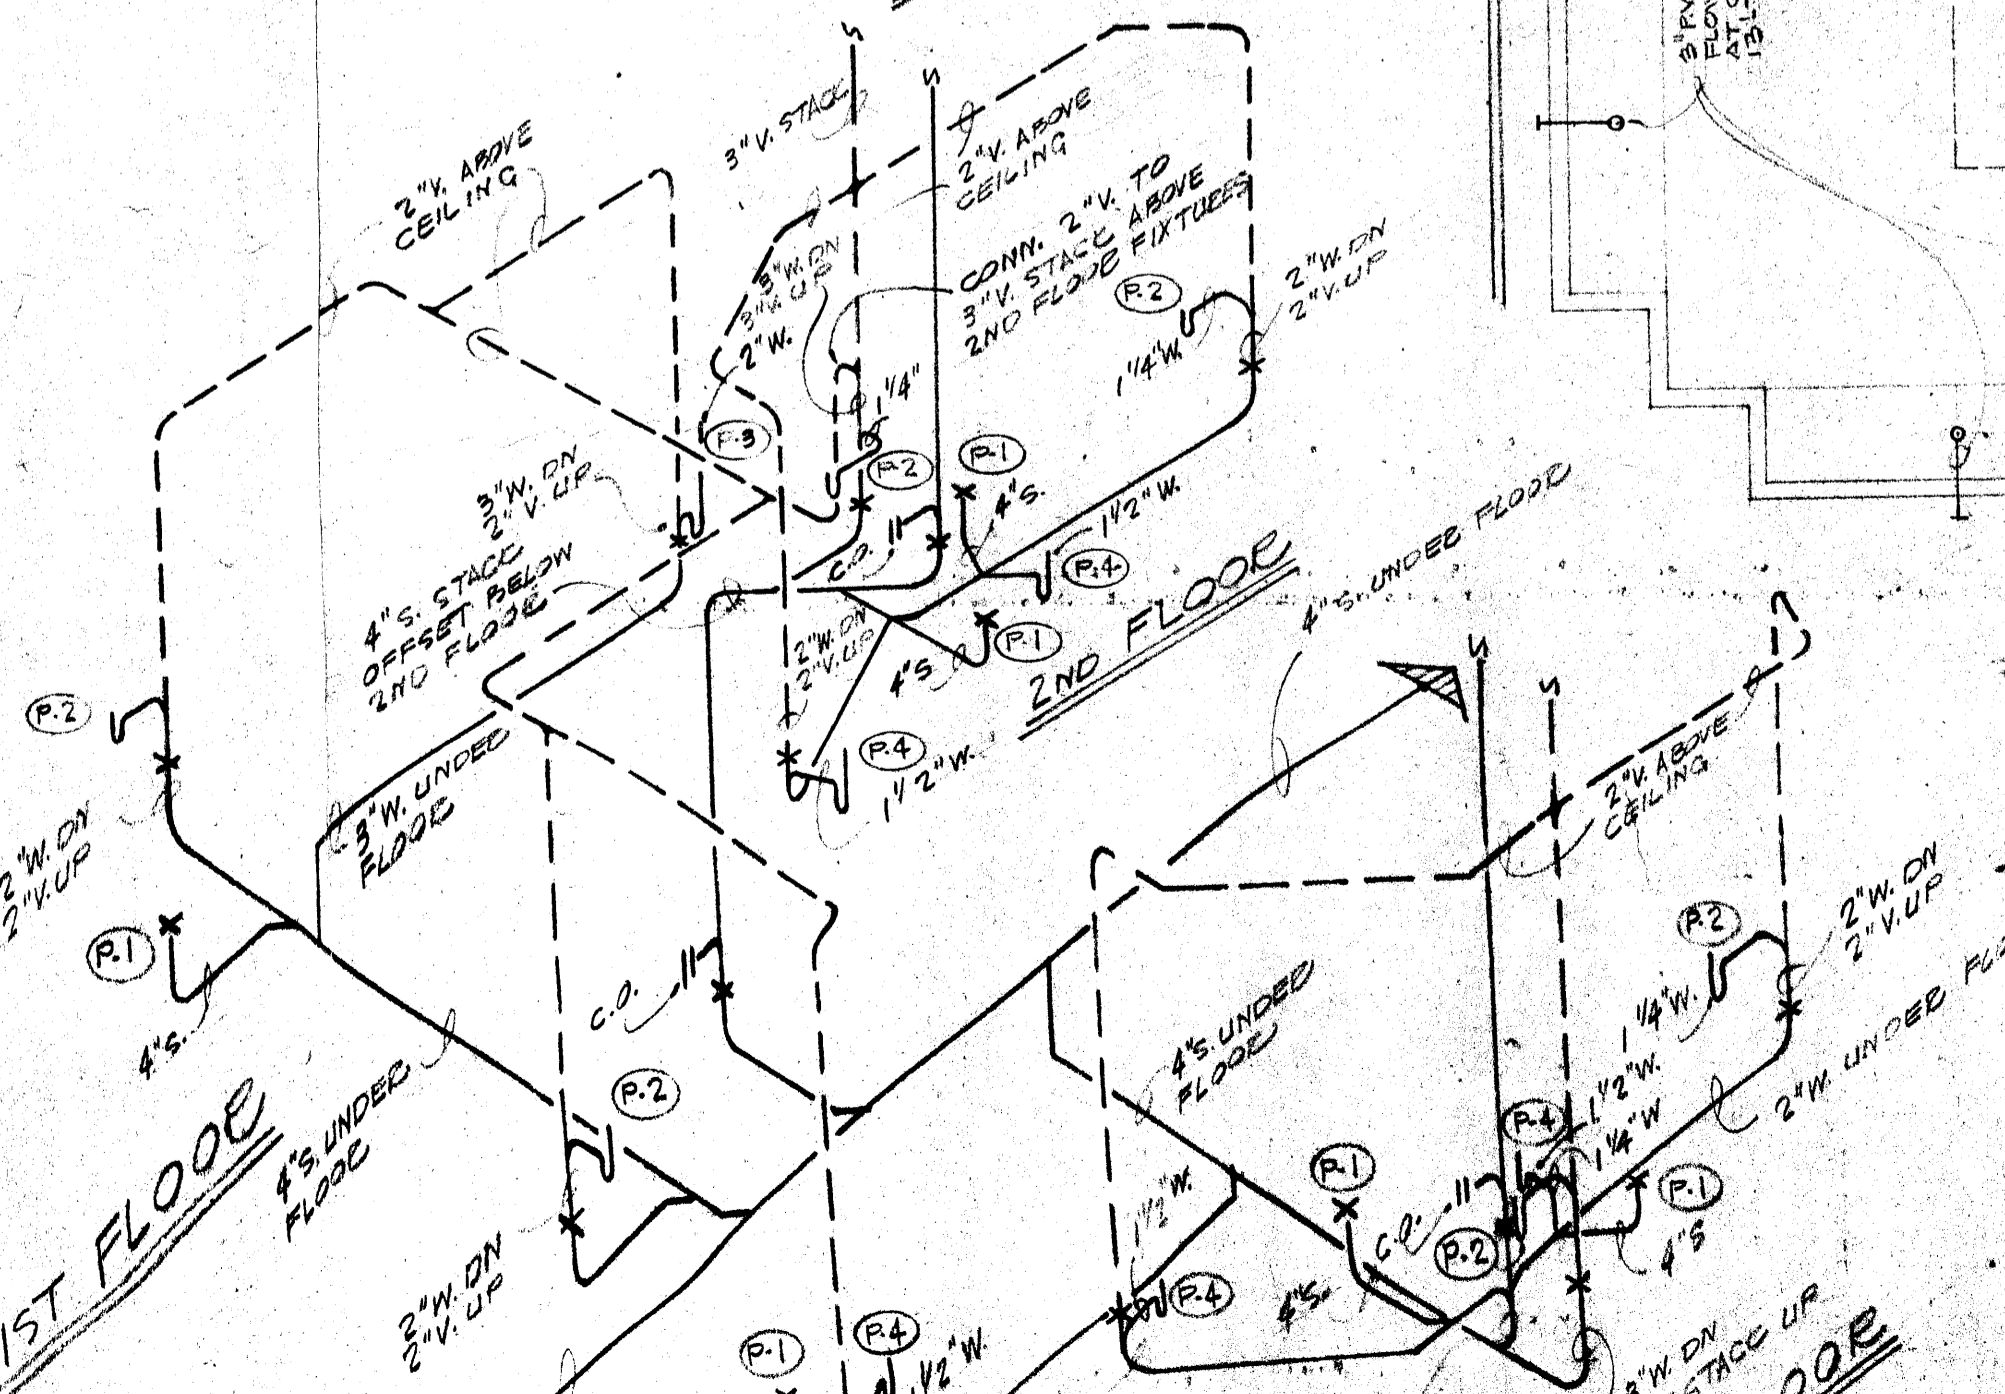
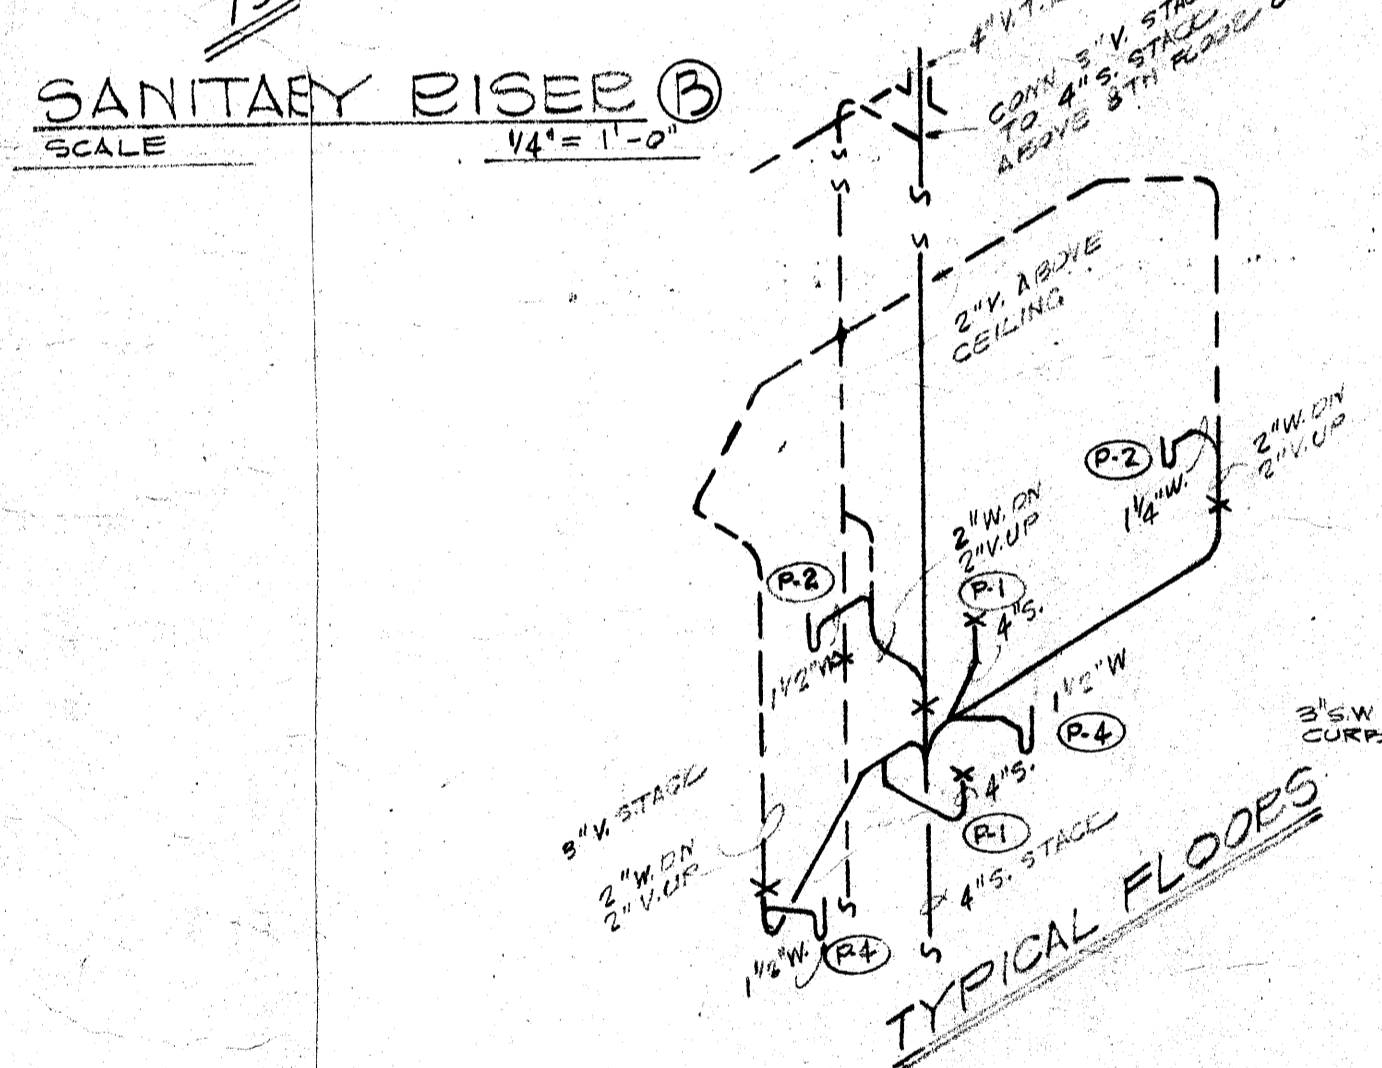


CAR PORT

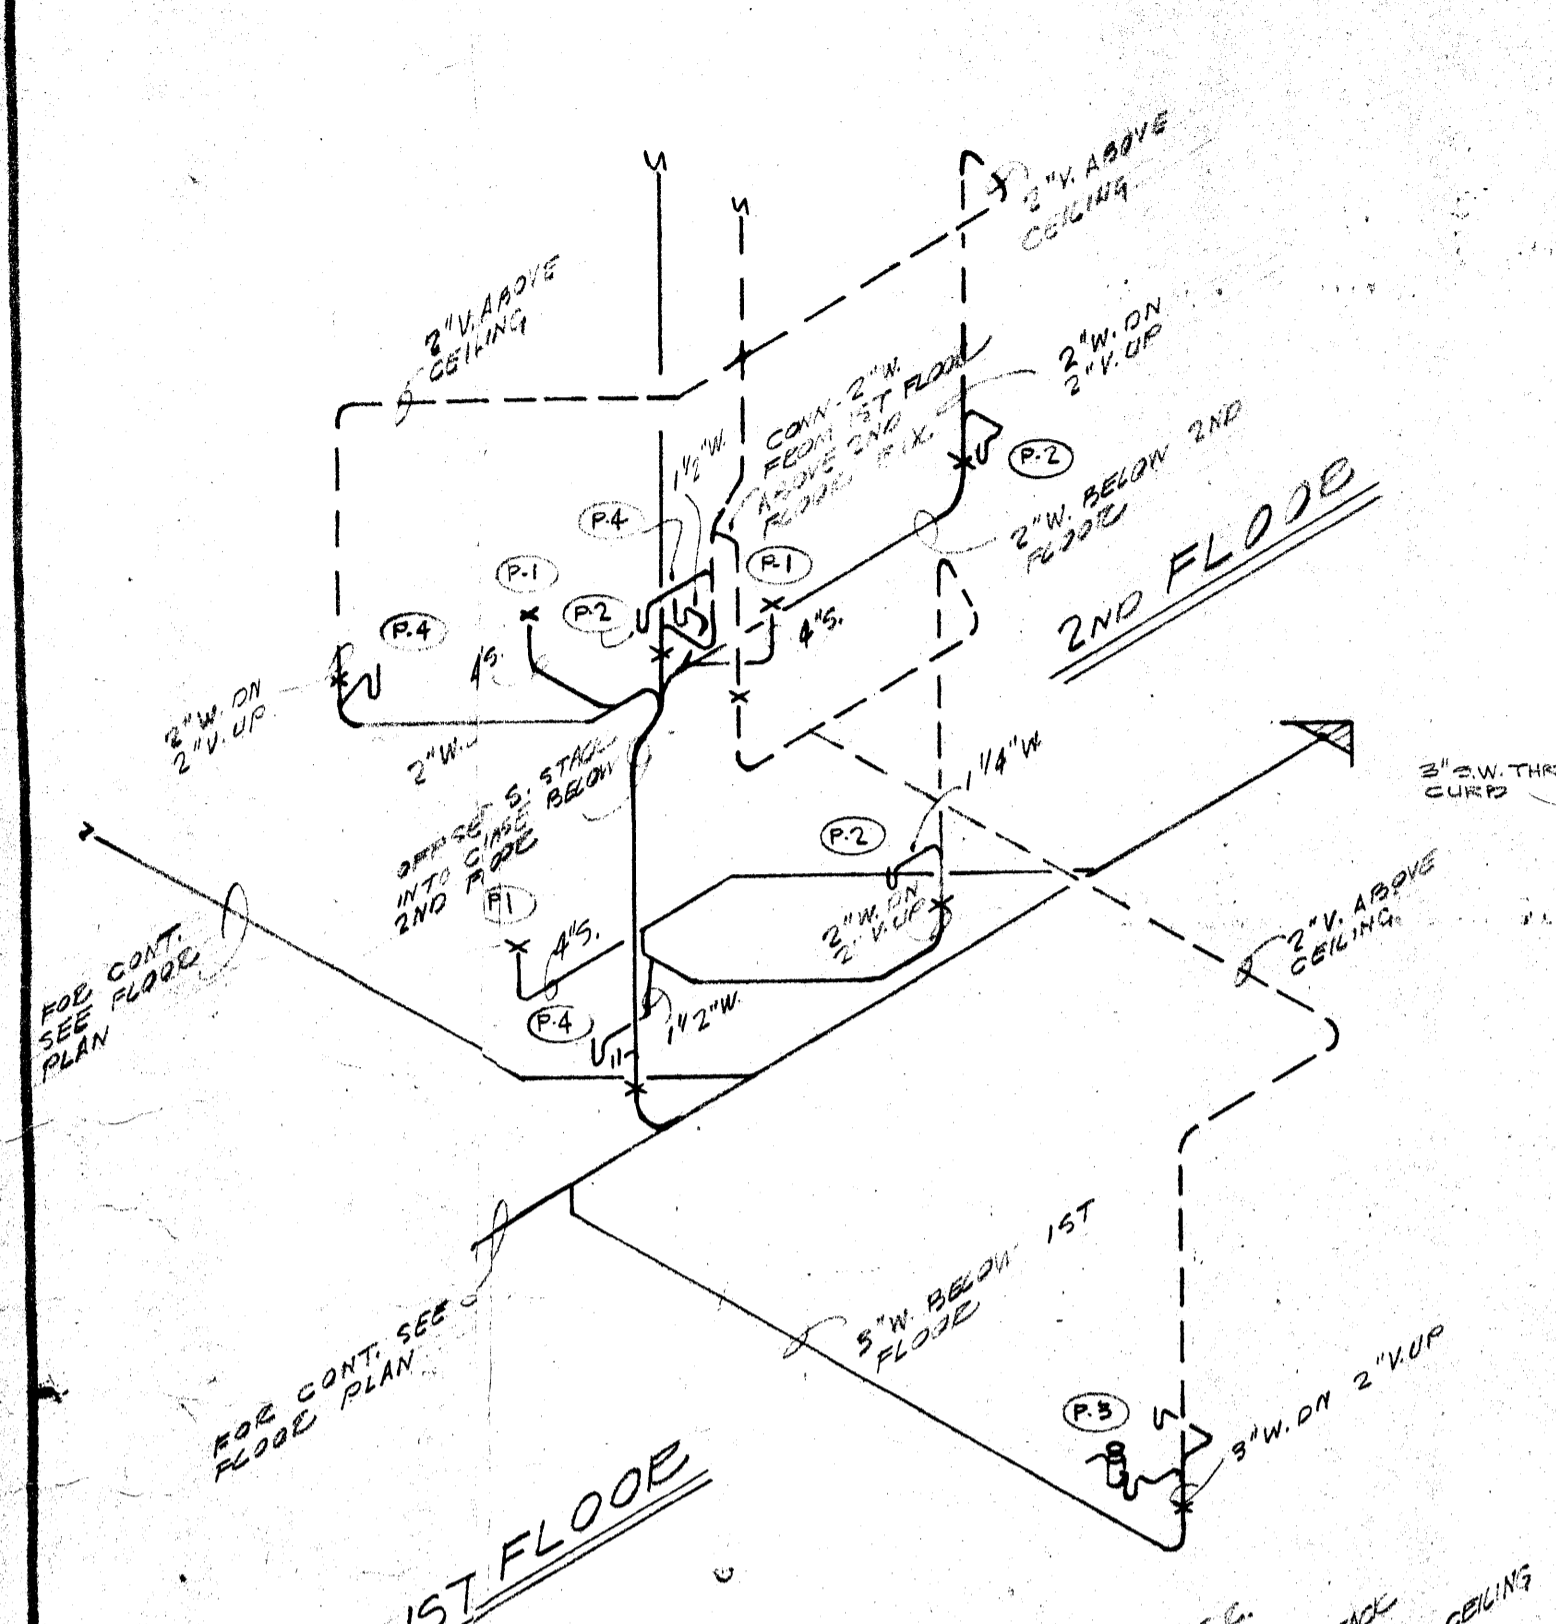

- LEGEND:**
- SW - SIDEWATER PIPING FROM ROOF
  - SANITARY WASTE OR SOIL PIPING
  - SANITARY VENT PIPING
  - VENT THRU EGG
  - - CLEANOUT
  - - TEST TEE CLEANOUT
  - FLOOD DEAIN
  - FLOOD MAIN
  - DOM. COLD WATER PIPING
  - DOM. HOT WATER PIPING
  - ⊙ CO2 - FIRE EXTINGUISHER (CO2)
  - ⊙ DC - FIRE EXTINGUISHER (DRY CHEMICAL)
  - ⊙ CD - A/C CONDENSATE DRAIN PIPING
  - XXX - HOT WATER TANK PRESSURE RELIEF PIPE
  - ⊙ - sump well

**OUTSIDE APARTMENTS**  
COLD WATER SHUTOFF  
⊙ 1ST FLOOR APARTMENTS  
UNDER KITCHEN SINK  
⊙ INSIDE APARTMENTS SHUT  
OFF - 1ST FL. ~~Lobby~~  
LOBBY ROOM

- GENERAL NOTES:**
1. THE PLUMBING SUB CONTRACTOR SHALL VERIFY THE LOCATION OF ALL EXISTING SERVICES AS TO SIZE, INV. ELEV. & LOCATION (WATER, SANITARY SEWER, ETC.)
  2. THE PLUMBING CONTRACTOR SHALL CO-ORDINATE HIS WORK WITH ALL OTHER TRADES & CONTRACTORS.
  3. ALL SANITARY PIPING BELOW PAVING FOR VEHICULAR TRAFFIC TO BE EXTRA HEAVY CAST IRON OR EXTRA HEAVY VITRIFIED CLAY PIPE.

PUMP SCHEDULE		
PUMP NUMBER	1	2
SERVICE	D.P.M. WATER	FIRE
MANUFACTURER	AUG 002	ALLIS CHALMERS
MODEL NUMBER	2 X 2 1/2 X 12 0 J	C 1 G 3 X 5 1/2
FLOW CAPACITY	GPM	120
TOTAL DYNAMIC HEAD	FT	80'
IMPELLER DIAMETER	IN	12"
PUMP MOTOR SPEED	RPM	1750
PUMP MOTOR HP	HP	5
PUMP MOTOR ELECTRIC DATA	208V. 30 G.C.C.	208V. 30 G.C.C.
SPECIAL REQUIREMENTS	SPECIAL (SEE SPEC) DEIN. PUMP.	
TYPE OF SHAFT SEAL	MECHANICAL	MECHANICAL
PUMP SECTION & DISCHARGE	2" X 2 1/2"	3" X 3"
CONC. BASE SIZE	AS ECR.	AS ECR.