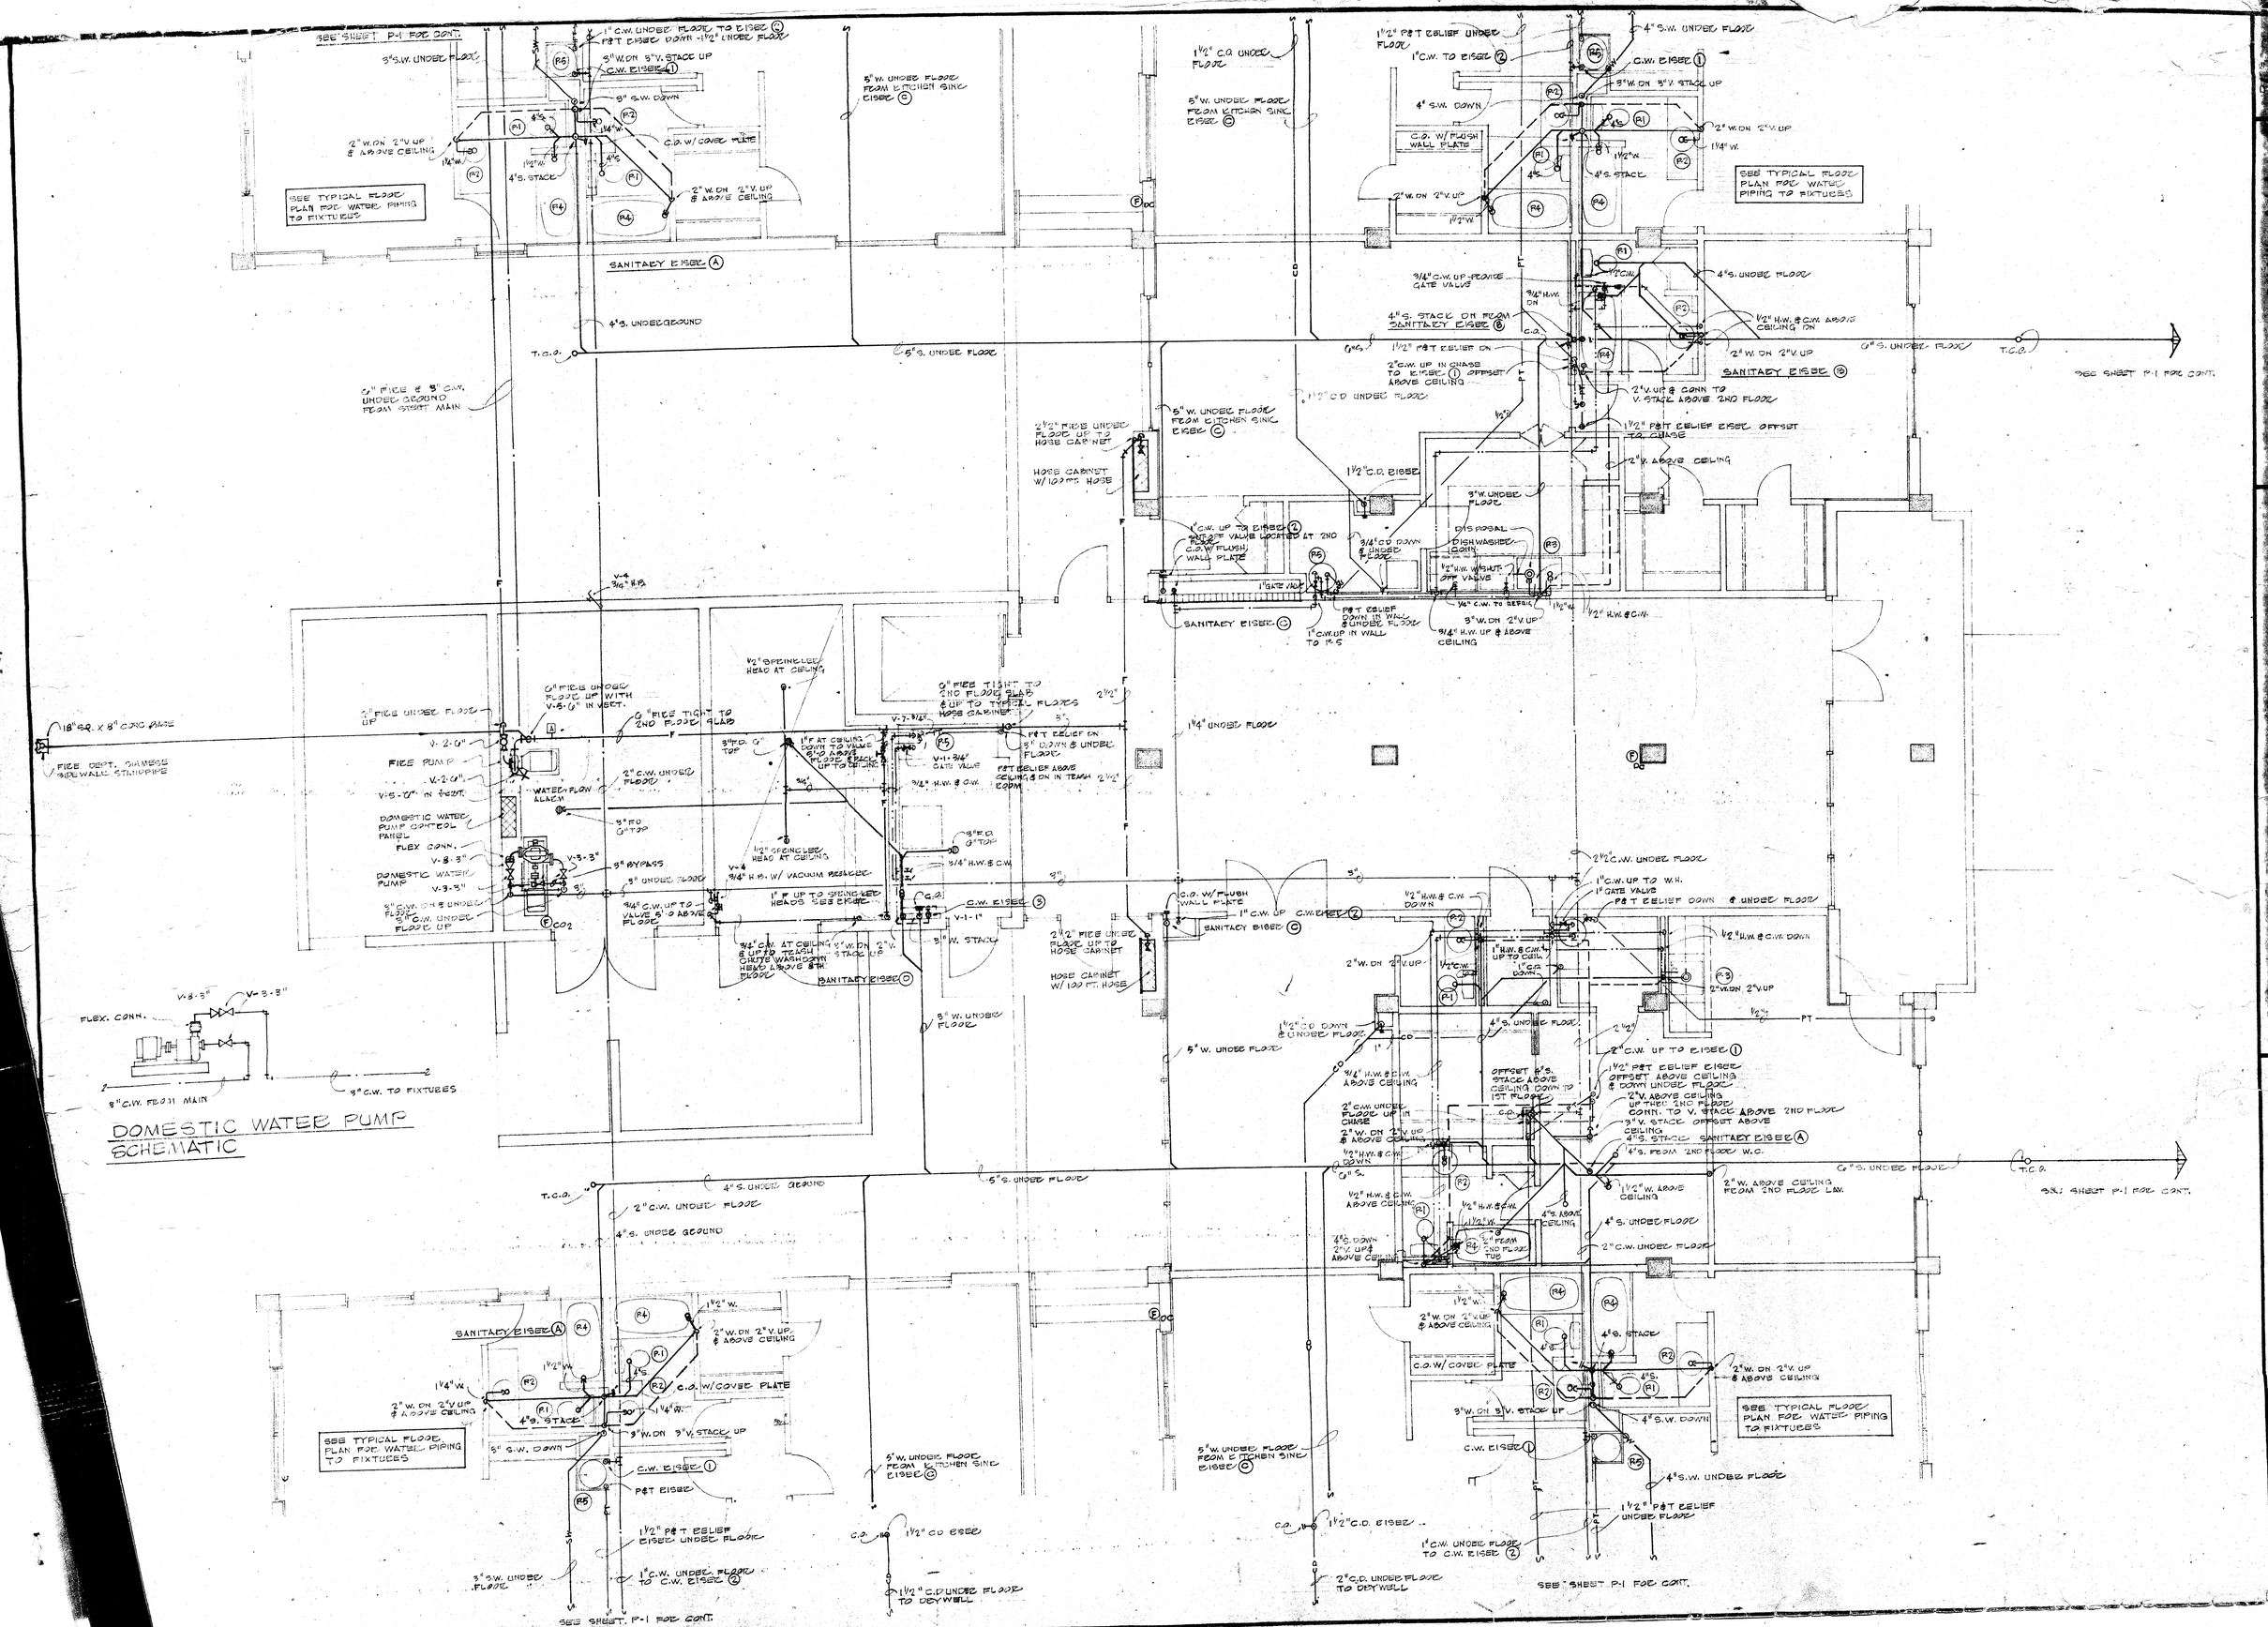
SEE SHEET P-1 FOR CONT.
3"S.W. UNDER FLOOR
1" C.W. UNDER FLOOR TO EISEC (C)
P&T EISEC DOWN - 1½" UNDER FLOOR
3"W. ON 3"V. STACK UP
C.W. EISEC (1)
3" S.W. DOWN
2" W. ON 2" V. UP & ABOVE CEILING
C.O. W/ COVER PLATE
4"S. STACK
SEE TYPICAL FLOOR PLAN FOR WATER PIPING TO FIXTURES
SANITARY EISEC (A)
4"S. UNDERGROUND
T.C.O.
5"S. UNDER FLOOR
6" FICE & 8" C.W. UNDER GROUND FROM STREET MAIN
5"W. UNDER FLOOR FROM KITCHEN SINK EISEC (C)
1½" C.O. UNDER FLOOR
1½" P&T RELIEF UNDER FLOOR
1" C.W. TO EISEC (2)
4" S.W. DOWN
C.O. W/ FLUSH WALL PLATE
2" W. ON 2" V. UP
4"S. STACK
SEE TYPICAL FLOOR PLAN FOR WATER PIPING TO FIXTURES
3/4" C.W. UP - PROVIDE GATE VALVE
4"S. UNDER FLOOR
4"S. STACK ON FLOOR SANITARY EISEC (B)
1½" P&T RELIEF ON
2" C.W. UP IN CHASE TO EISEC (1) OFFSET ABOVE CEILING
½" H.W. & C.W. ABOVE CEILING ON
2" W. ON 2" V. UP
SANITARY EISEC (B)
2" V. UP & CONN TO V. STACK ABOVE 2ND FLOOR
1½" P&T RELIEF EISEC OFFSET TO CHASE
2" V. ABOVE CEILING
1½" C.O. EISEC
3" W. UNDER FLOOR
DISPOSAL
DISHWASHER LOWN
½" H.W. W/ SHUT OFF VALVE
¼" C.W. TO REPAIR
3" W. ON 2" V. UP
3/4" H.W. UP & ABOVE CEILING
½" H.W. & C.W.
1½" W.
1" C.W. UP TO EISEC (2) GATE VALVE LOCATED AT 2ND FLOOR
C.O. W/ FLUSH WALL PLATE
3/4" C.O. DOWN & UNDER FLOOR
1" GATE VALVE
P&T RELIEF DOWN IN WALL & UNDER FLOOR
1" C.W. UP IN WALL TO K.S.
SANITARY EISEC (C)
5" W. UNDER FLOOR FROM KITCHEN SINK EISEC (C)
HOSE CABINET W/ 100 FT. HOSE
V-4 3/4" H.P.
½" SPRINKLER HEAD AT CEILING
6" FICE UNDER FLOOR UP WITH V-6'-0" IN VENT.
6" FICE TIGHT TO 2ND FLOOR SLAB
6" FICE TIGHT TO 2ND FLOOR SLAB & UP TO TYPICAL FLOORS HOSE CABINET
2½"
5"
2½" FICE UNDER FLOOR UP
18" SQ. X 8" CONC. BASE
V-2-0"
FICE PUMP
V-2-0"
V-5-0" IN VENT.
FICE DEPT. DIAMESE SIDEWALL STANDPIPE
WATER FLOW ALARM
2" C.W. UNDER FLOOR
3" FD G" TOP
1" F AT CEILING DOWN TO VALVE 5'-0 ABOVE FLOOR & BACK UP TO CEILING
V-7-3/4"
V-1-3/4" GATE VALVE
P&T RELIEF ON 3" DOWN & UNDER FLOOR
3/4" H.W. & C.W.
P&T RELIEF ABOVE CEILING & ON IN TEMPA COMM.
1¼" UNDER FLOOR
DOMESTIC WATER PUMP CONTROL PANEL
FLEX CONN.
V-3-3"
DOMESTIC WATER PUMP
V-3-3"
3" BYPASS
3" UNDER FLOOR
½" SPRINKLER HEAD AT CEILING
V-4 3/4" H.P. W/ VACUUM RELIEF
3" FD G" TOP
3/4" H.W. & C.W.
3/4" C.W. UP TO VALVE 5'-0 ABOVE FLOOR
1" F UP TO SPRINKLED HEADS SEE EISEC
C.O.
C.W. EISEC (3)
V-1-1"
3" W. STACK
3/4" C.W. AT CEILING & UP TO FLUSH CHUTE WASH DOWN HEAD ABOVE F.W. FLOOR
2" W. ON 2" V. STACK UP
SANITARY EISEC (D)
2½" FICE UNDER FLOOR UP TO HOSE CABINET
HOSE CABINET W/ 100 FT. HOSE
3" W. UNDER FLOOR
5" W. UNDER FLOOR
C.O. W/ FLUSH WALL PLATE
1" C.W. UP C.W. EISEC (2)
SANITARY EISEC (C)
½" H.W. & C.W. DOWN
2½" C.W. UNDER FLOOR
1" C.W. UP TO W.H.
1" GATE VALVE
P&T RELIEF DOWN & UNDER FLOOR
½" H.W. & C.W. DOWN
1" H.W. & C.W. UP TO CEIL.
1" C.O. DOWN
2" W. ON 2" V. UP
2" W. ON 2" V. DN
1½" C.O. DOWN & UNDER FLOOR
4"S. UNDER FLOOR
2" C.W. UP TO EISEC (1)
1½" P&T RELIEF EISEC OFFSET ABOVE CEILING & DOWN UNDER FLOOR
3/4" H.W. & C.W. ABOVE CEILING
OFFSET 8"S. STACK ABOVE CEILING DOWN TO 1ST FLOOR
2" V. ABOVE CEILING UP THRU 2ND FLOOR CONN. TO V. STACK ABOVE 2ND FLOOR
3" V. STACK OFFSET ABOVE CEILING
2" C.W. UNDER FLOOR UP IN CHASE
2" W. ON 2" V. UP & ABOVE CEILING
4"S. STACK SANITARY EISEC (A)
4"S. FROM 2ND FLOOR W.C.
½" H.W. & C.W. DOWN
6"S.
½" H.W. & C.W. ABOVE CEILING
½" H.W. & C.W.
½" W.
4"S. ABOVE CEILING
2" W. ABOVE CEILING FROM 2ND FLOOR LAV.
4"S. UNDER FLOOR
2" C.W. UNDER FLOOR
4"S. DOWN 2" V. UP & ABOVE CEILING
2" FROM 2ND FLOOR TUB
FLEX. CONN.
V-3-3"
V-3-3"
8" C.W. FROM MAIN
3" C.W. TO FIXTURES
DOMESTIC WATER PUMP SCHEMATIC
4" S. UNDER GROUND
2" C.W. UNDER FLOOR
4"S. UNDER GROUND
SANITARY EISEC (A)
1½" W.
2" W. ON 2" V. UP & ABOVE CEILING
1¼" W.
C.O. W/ COVER PLATE
4"S. STACK
3" W. ON 3" V. STACK UP
5" S.W. DOWN
SEE TYPICAL FLOOR PLAN FOR WATER PIPING TO FIXTURES
C.W. EISEC (1)
P&T EISEC
1½" P&T RELIEF EISEC UNDER FLOOR
3" S.W. UNDER FLOOR
1" C.W. UNDER FLOOR TO C.W. EISEC (2)
5" W. UNDER FLOOR FROM KITCHEN SINK EISEC (C)
C.O.
1½" C.O. EISEC
1½" C.O. UNDER FLOOR TO DRY WELL
5" W. UNDER FLOOR FROM KITCHEN SINK EISEC (C)
C.O.
1½" C.O. EISEC
2" C.O. UNDER FLOOR TO DRY WELL
4" S.W. DOWN
4"S.W. UNDER FLOOR
1½" P&T RELIEF UNDER FLOOR
1" C.W. UNDER FLOOR TO C.W. EISEC (2)
SEE SHEET P-1 FOR CONT.
SEE SHEET P-1 FOR CONT.